



Eljen GSF[®] A/B SYSTEM


ABSORPTION AREA WITH CONNECTIONS TO PUMP CHAMBER

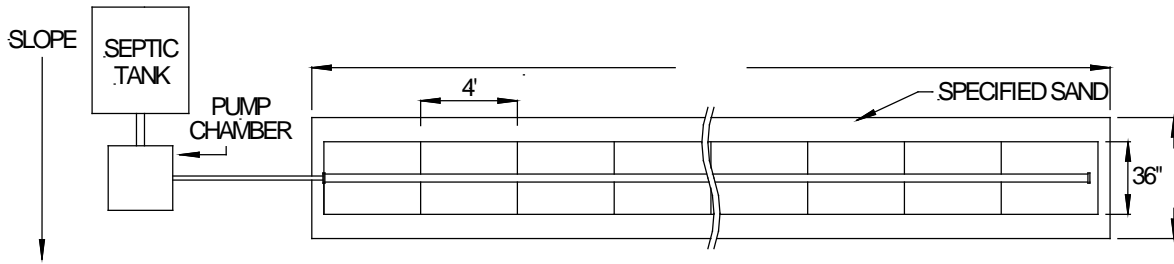

PLAN VIEW

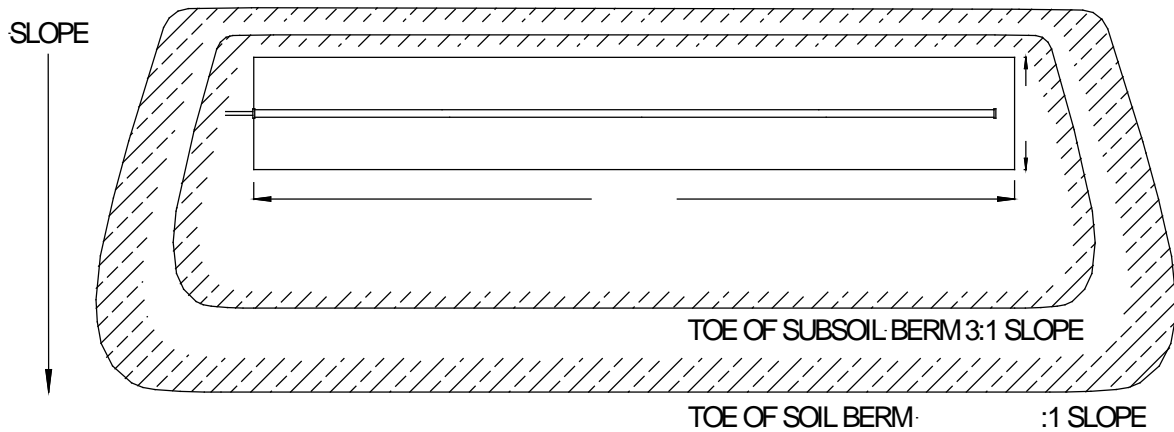

CROSS SECTION VIEW

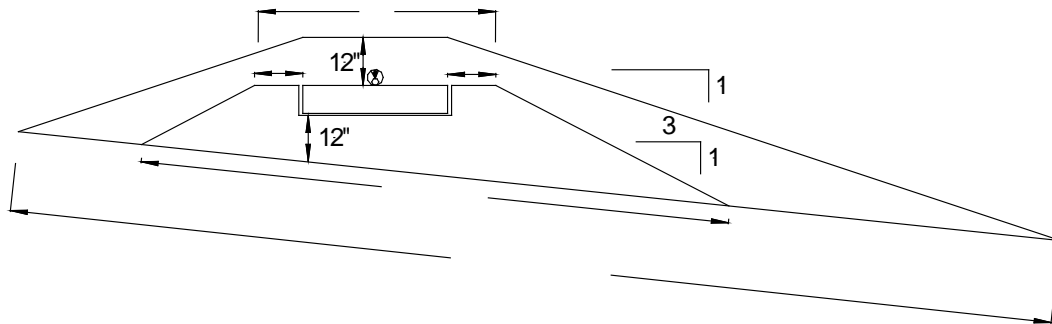

Notes:

1. On sites with slopes greater than 8% but less than 12% the berm shall be a minimum of 3:1 slope.
2. On sites with slopes of 12 – 15%, the berm shall be a minimum of 4:1.

NOT TO SCALE